

LAMPIRAN




# DISTRIBUTION TRANSFORMER

◇ L M K ◇


PHASE	3	SERIAL NO.	11237589	
FREQUENCY Hz	50	YEAR OF MANUFACTURE	2011	
VVA	1000	STANDARD	SPLN 50/97	
VOLTS	HV style="text-align: center;">20000	TYPE OF COOLING	ONAN	
	LV style="text-align: center;">400	VECTOR GROUP	DYN5	
AMPERE	HV style="text-align: center;">28.86	TEMP. RISE OIL/WINDING °C	50 / 55	
	LV style="text-align: center;">1443.37	HI / LV WINDING MATERIAL	Cu / Al	
IMPEDANCE %	5.0	TRANSFORMER OIL LITRE	850	
INSULATION CLASS	A	TRANSFORMER WEIGHT kg	3000	
BIL (kV) HV	LIUSAC50/LI-AC3			


HCTAFVOLT	SW/POS
22000	1
21000	2
20000	3
19000	4
18000	5

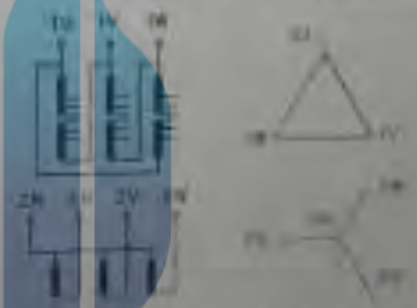

pt. trafoinda prima perkasa

UNIVERSITAS  
MERCU BUANA

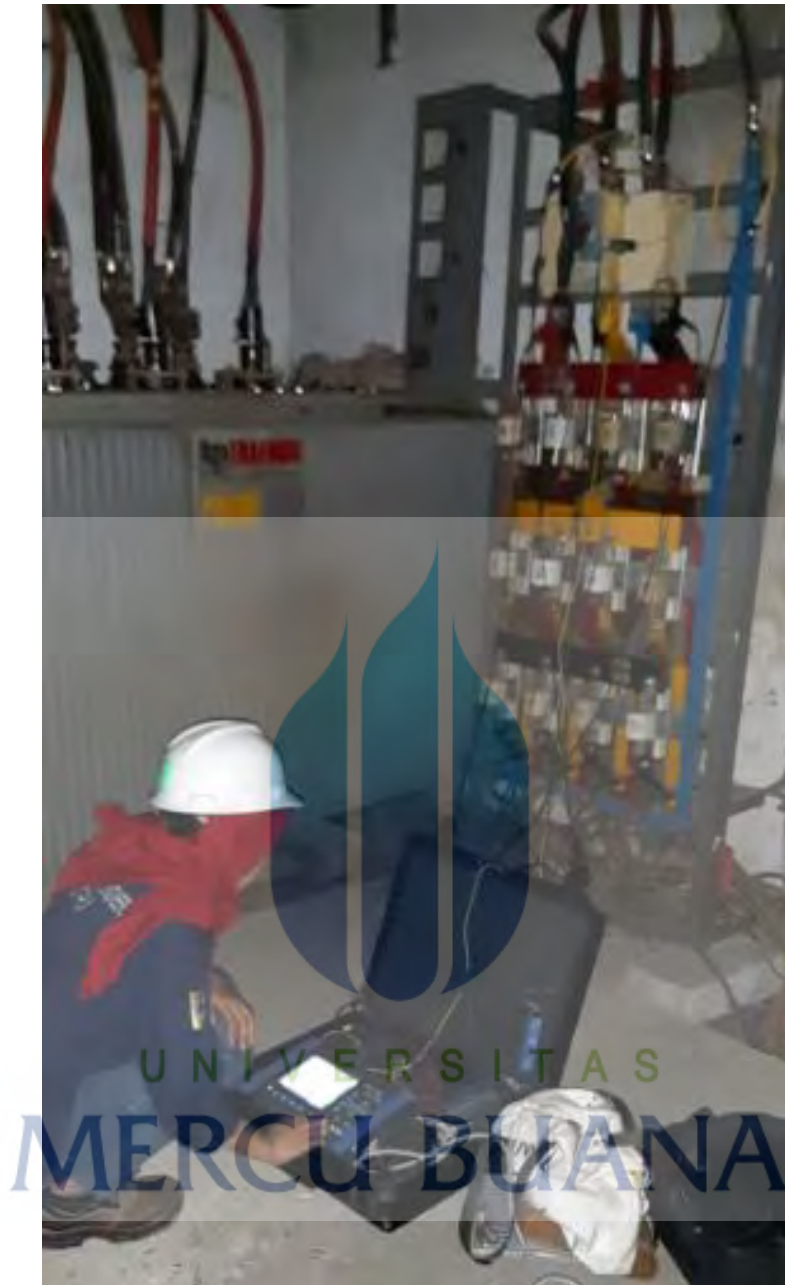

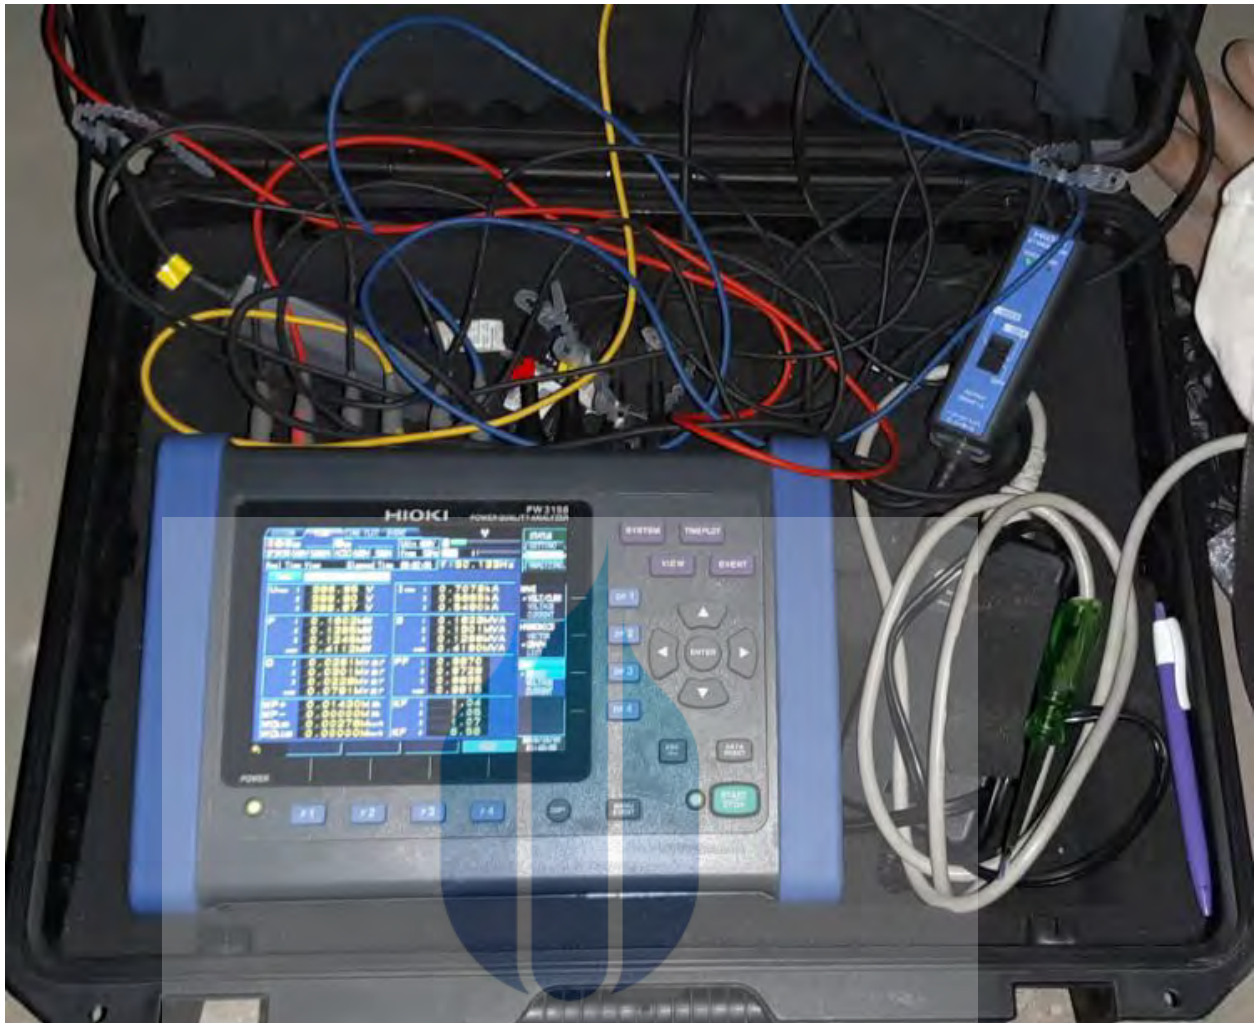

UNIVERSITAS  
MERCU BUANA